



SINGLE SERVICE

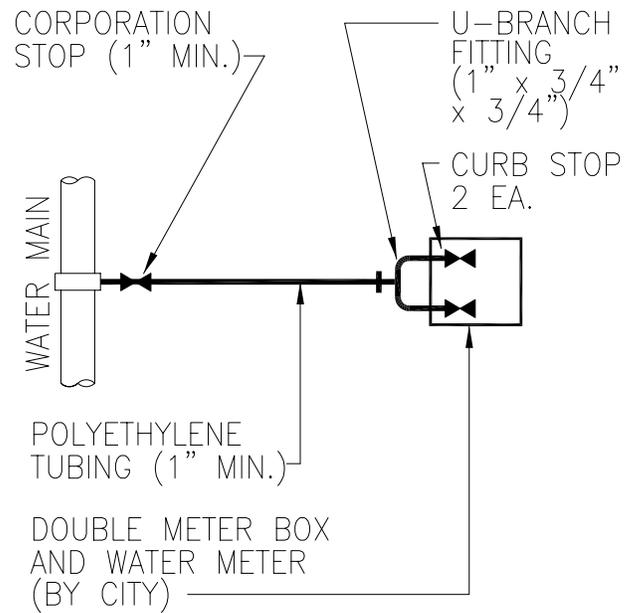

DOUBLE SERVICE

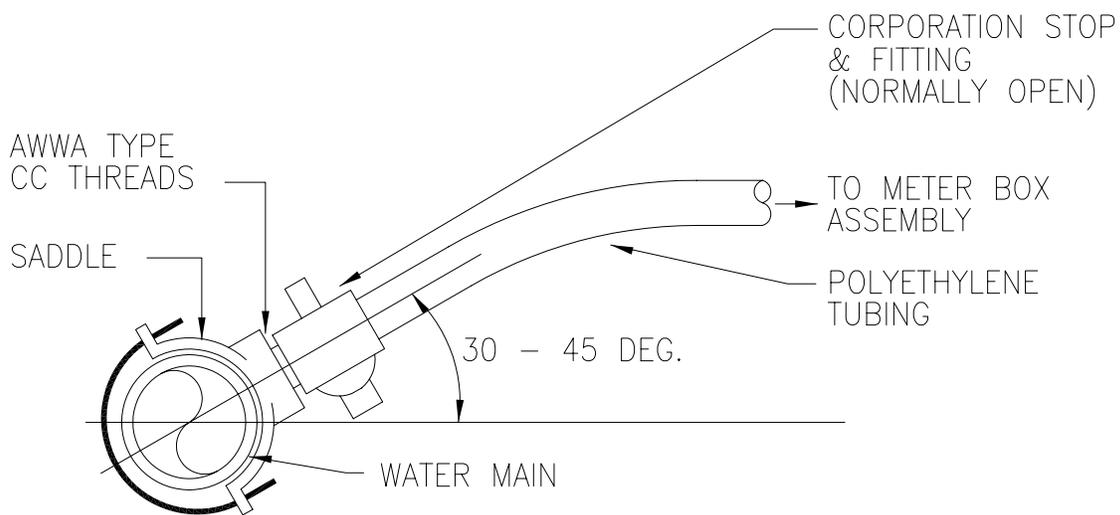

NOTES:

1. ALL FITTINGS SHALL BE BRASS WITH COMPRESSION/PACK JOINT TYPE CONNECTIONS.
2. NO SERVICE LINE SHALL TERMINATE UNDER A DRIVEWAY.
3. EACH SERVICE SHALL TERMINATE AT A CURB STOP(S) WHICH SHALL BE EXPOSED APPROXIMATELY 3' ABOVE FINAL GRADE AND TIED TO A 2" x 4" x 4" STAKE WITH THE TOP PAINTED BLUE AND MARKED WITH THE NUMBER OF THE LOT(S) TO BE SERVED.

CITY OF MASCOTTE UTILITIES DEPARTMENT

WATER SERVICE CONNECTION DETAILS

DATE:

DWG: SERVCONN

FIG: 405