


MOUNTING BRACKET

ALARM LIGHT

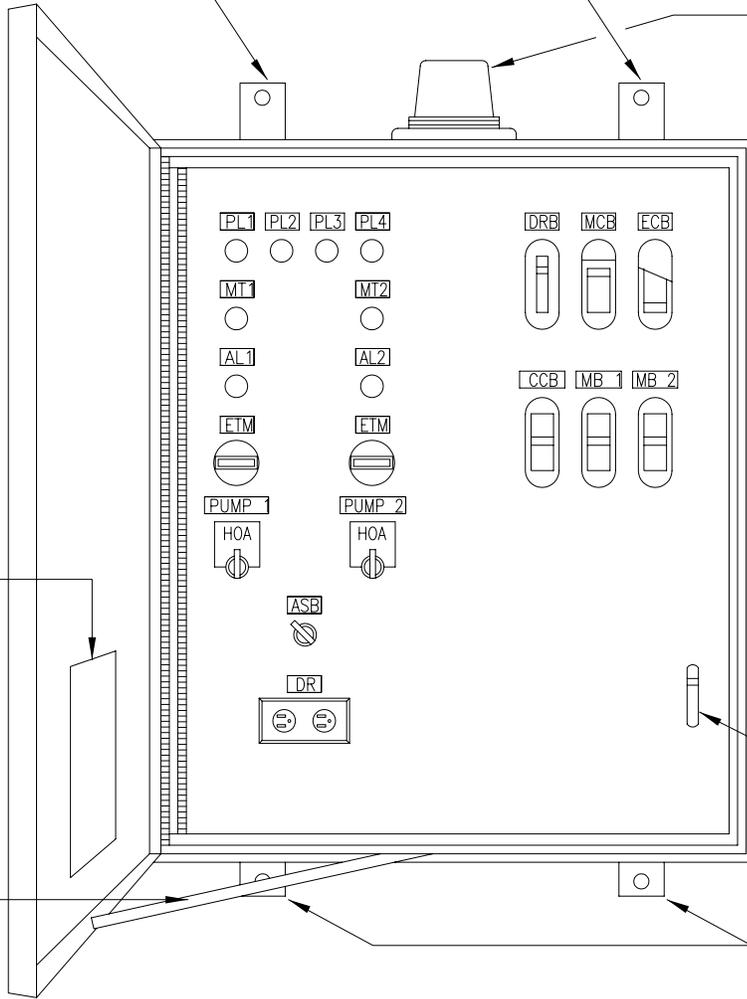

POCKET

GENERATOR RECEPTACLE

ALARM HORN

DOOR STOP WITH LOCK FOR DEAD FRONT.

PAD LOCK BRACKET

DOOR LATCH

MOUNTING BRACKETS

NOTES:

1. OUTER BOX SIZE SHALL BE A MINIMUM OF 24"W X 36"H X 10"D OR AS APPROVED BY THE CITY.
2. FOR STATIONS WITH PUMPS RATED 20 HP OR GREATER, OUTER BOX SIZE SHALL BE 30"W X 42"H X 10"D AND SHALL HAVE 2 LATCHES ON THE DEAD FRONT.
3. DRAWINGS SHALL BE REVISED FOR STATIONS WITH PUMPS RATED GREATER THAN 47 HP AND SUBMITTED TO THE CITY FOR APPROVAL.

CITY OF MASCOTTE UTILITIES DEPARTMENT

DUPLEX CONTROL
PANEL ENCLOSURE
DEAD FRONT LAYOUT

DATE:

DWG: DUPLEX

FIG: 303