



STANDARD DROP DETAIL

TRANSITE COLLAR ENCASED  
IN NON-SHRINK GROUT  
FLUSH WITH MANHOLE WALL  
(SEE NOTE 2)

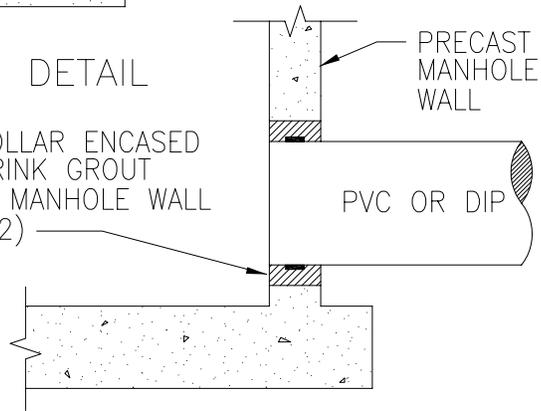

SPECIAL DETAIL FOR 24" DIAMETER  
PIPE AND LARGER

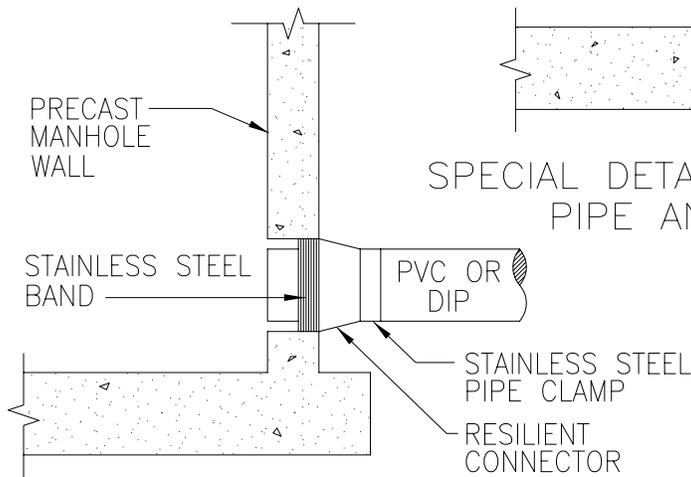

STANDARD PRECAST MANHOLE  
PIPE CONNECTION

NOTES:

1. DROP PIPE AND FITTINGS SHALL BE OF EQUAL SIZE AND MATERIAL AS THE INFLUENT SEWER.
2. THE CITY MAY APPROVE ALTERNATE WATER TIGHT CONNECTION DETAILS FOR CONNECTION OF 24" DIAMETER PIPES AND LARGER.
3. AN OUTSIDE DROP CONNECTION SHALL BE REQUIRED FOR ALL INFLUENT LINES WHICH HAVE AN INVERT 2' OR MORE ABOVE THE MANHOLE INVERT.

CITY OF MASCOTTE UTILITIES DEPARTMENT

MANHOLE CONNECTION DETAILS

DATE:

DWG: MHCON

FIG: 201